


YN7571

Ceiling-mounted Thermal Responsive Smoke Sensor Module

User Manual

File Version: V25.4.16

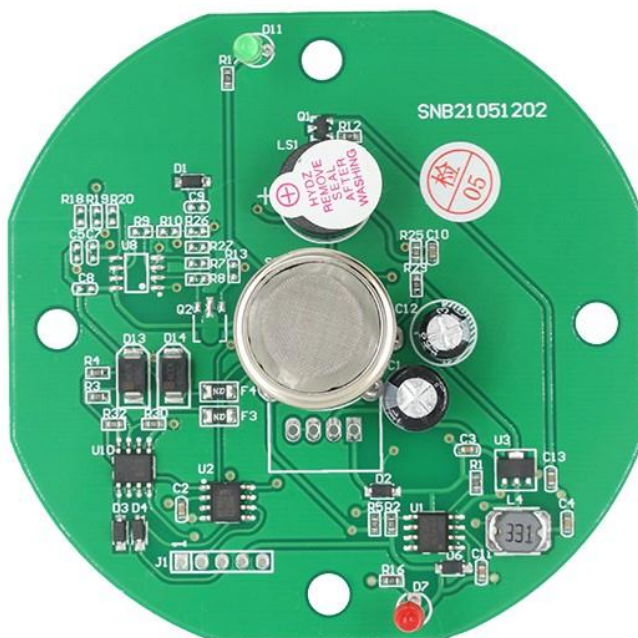

YN7571 using the standard ,easy access to PLC , DCS and other instruments or systems for monitoring conductivity2000 state quantities.The internal use of high-precision sensing core and related devices to ensure high reliability and excellent long-term stability,can be customized RS232,RS485,CAN,4-20mA,DC0~5V\10V,ZIGBEE,Lora,WIFI,GPRS and other output methods.

Technical Parameters

Shanghai hitdo Industrial Co.,Ltd INTOIOT Brand Division

Page1

Technical parameter	Parameter value
Smoke measuring range	0~2000ppm
Smoke allow deviation	± 7%
Smoke Repeatability test	± 5%
Smoke detection chip	Import digital
Temperature characteristics	± 0.5%/°C
Interface	RS485/4-20mA/DC0-5V
Power	DC9~26V/DC12~26V/DC9~26V
Running temperature	-30~80°C
Working humidity	5%RH~90%RH

Product Selection

Product Design RS485, 4-20mA, DC0-5V Multiple output methods, the products are divided into the following models depending on the output method.

Product model	output method
YN7571B	RS485 总线
YN7571M	4-20mA
YN7571V5	DC0-5V

In the case of broken wires, wire the wires as shown in the figure. If the product itself has no leads, the core color is for reference.

Communication Protocol

The product uses the RS485 MODBUS-RTU standard protocol format, and all operation or reply commands are in hexadecimal data. When the device leaves the factory, the default device address is 1, and the default baud rate is: for modules and non-recording instruments: 9600, 8, n, 1 (for the recorder series products, the default is: 115200, 8, n, 1).

1. Read data (Function code 0x03)

The inquiry frame (in hexadecimal). Example of sending: To query 1 piece of data of device No. 1, the host computer sends the command: 01 03 00 00 00 01 84 0A .

Address	Function code	Starting address	Data length	Checksum
01	03	00 00	00 01	84 0A

For a correct inquiry frame, the device will respond with data: 01 03 02 02 18 B9 2E , and the response format is:

Address	Function code	Length	Data 1	Checksum
01	03	02	02 18	B9 2E

Data description: The data in the command is in hexadecimal. Taking Data 1 as an example, 02 18 converted to decimal value is 536. Generally, for products of Soubo, the magnification factor of illuminance data is 1 or 10. The magnification factor of this product is 1, then the true value is: $536/1 = 536$, and the others can be deduced by analogy.

2. Common Data Address Table

Configuration Address	Register Address	Register Description	Data Type	Value Range
40001	00 00	conductivity	Read Only	0~65535

40101	00 64	Model Code	Read-only	0~59999
40102	00 65	Total Number of Measuring Points	Read-only	1~1600
40103	00 66	Device Address	Read/Write	1~249
40104	00 67	Baud Rate	Read/Write	0~6
40105	00 68	Communication Mode	Read/Write	1 Query
40106	00 69	Protocol Type	Read/Write	1 MODBUS-RTU

3. Read and modify the device address

(1) Read or query the device address

If you don't know the current device address and there is only one device on the bus, you can query the device address through the command FA 03 00 66 00 01 71 9E .

Device address	Function code	Starting address	Data length	Checksum
FA	03	00 66	00 01	71 9E

FA, which is 250, is the universal address. When you don't know the address, you can use 250 to obtain the real device address. 00 66 is the register of the device address.

For a correct query command, the device will respond. For example, the response data is: 01 03 02 00 01 79 84. The format analysis is shown in the following table:

Device address	Function code	Starting address	Address ID	Checksum
01	03	02	00 01	79 84

In the response data, the first byte 01 represents the real address of the current device.

(2) Change the device address

For example, if the current device address is 1 and you want to change it to 02, the command is: 0 1 06 00 66 00 02 E8 14 .

Device address	Function code	Register address	Target address	Checksum
01	06	00 66	00 02	E8 14

After the change is successful, the device will return the information: 02 06 00 66 00 02 E8 27. The format analysis is shown in the following table:

Device address	Function code	Register address	Target address	Checksum
02	06	00 66	00 02	E8 27

In the response data, after the modification is successful, the first byte is the new device address. Generally, after the device address is changed, it takes effect immediately. At this time, users need to modify the query commands in their own software accordingly.

4. Read and modify the baud rate

(1) Read the baud rate

The default factory baud rate of the device is 9600. If you need to change it, you can perform the change operation according to the following table and the corresponding communication protocol. For example, to read the baud rate ID of the current device, the command is: 01 03 00 67 00 01 35 D5 . The format analysis is as follows.

Device address	Function code	Starting address	Data length	Checksum
01	03	00 67	00 01	35 D5

Read the baud rate code of the current device. Baud rate codes: 1 for 2400; 2 for 4800; 3 for 9600; 4 for 19200; 5 for 38400; 6 for 115200.

For a correct query command, the device will respond. For example, the response data is: 01 03 02 00 03 F8 45. The format analysis is shown in the following table:

Device address	Function code	Data length	Baud rate code	Checksum
01	03	02	00 03	F8 45

According to the baud rate code, 03 represents 9600, which means the current baud rate of the device is 9600.

(2) Change the baud rate

For example, to change the baud rate from 9600 to 38400, that is, change the code from 3 to 5, the command is: 01 06 00 67 00 05 F8 16 .

Device address	Function code	Register address	Target baud rate	Checksum
01	06	00 67	00 05	F8 16

Change the baud rate from 9600 to 38400, that is, change the code from 3 to 5. The new baud rate will take effect immediately. At this time, the device will stop responding, and the query command for the device's baud rate needs to be modified accordingly.

5. Read and modify the correction value (valid for some products)

(1) Read the correction value

When there is an error between the data and the reference standard, we can reduce the display error by adjusting the "correction value". The adjustable range of the correction difference is plus or minus 1000, that is, the value range is 0 - 1000 or 64535 - 65535. For example, when the displayed value is 100 less than the actual value, we can correct it by adding 100. The command is: 01 03 00 6B 00 01 F5 D6 . In the command, 100 is the hexadecimal value 0x64. If you need to decrease the value, you can set a negative value. For example, - 100 corresponds to the hexadecimal value FF 9C. The calculation method is 100 - 65535 = 65435, and then convert it to hexadecimal, which is 0x FF 9C. The device correction value starts from 00 6B. We take the first parameter as an example for illustration. When there are multiple parameters, the methods for reading and modifying the correction value are the same.

Device address	Function code	Starting address	Data length	Checksum
01	03	00 6B	00 01	F5 D6

For a correct query command, the device will respond. For example, the response data is: 01 03 02 00 64 B9 AF. The format analysis is shown in the following table:

Device address	Function code	Data length	Correction value	Checksum
01	03	02	00 64	B9 AF

In the response data, the first byte 01 represents the real address of the current device, and 00 6B is the register for the correction value of the first state variable. If the device has multiple parameters, the operation methods for other parameters are the same. Generally, temperature and humidity sensors have this parameter, while light sensors usually do not.

(2) Change the correction value

For example, if the current state variable value is too small and we want to increase its real - value by 1, the command to correct the current value by adding 100 is: 01 06 00 6B 00 64 F9 FD .

Device address	Function code	Register address	Target address	Checksum
01	06	00 6B	00 64	F9 FD

After the operation is successful, the device will return the information: 01 06 00 6B 00 64 F9 FD. After the change is successful, the parameter takes effect immediately.

6. Read and modify the alarm threshold

(1) Read the alarm threshold

When the actual alarm threshold needs adjustment, we can read or adjust the “alarm threshold” through the following communication protocol. The adjustable range of the threshold is from 100 to 1000. For example, to read the current alarm threshold, the command is: 01 03 00 6C 00 01 44 17 . In the command, 108 is the hexadecimal value 0x6C.

Device address	Function code	Starting address	Data length	Checksum
01	03	00 6C	00 01	44 17

For a correct query command, the device will respond. For example, the response data is: 01 03 02 03 E8 B8 FA. The format analysis is shown in the following table:

Device address	Function code	Data length	Correction value	Checksum
01	03	02	03 E8	B8 FA

In the response data, the first byte 01 represents the real address of the current device, and 03 E8 is the register parameter value.

(2) Change the alarm threshold

For example, if the current alarm threshold is too small and we want to change it to 1000, the operation command is: 01 06 00 6C 03 E8 49 69 .

Device address	Function code	Register address	Target address	Checksum
01	06	00 6C	03 E8	49 69

After the operation is successful, the device will return the message 01 06 00 6C 03 E8 49 69. After the change is successful, the parameter takes effect immediately.

For example, the range is 0~2000ppm, the analog output is 4~20mA current signal, conductivity and current The calculation relationship is as shown in the formula: $C = (A2-A1) * (X-B1) / (B2-B1) + A1$, where A2 is conductivity range upper limit, A1 is the lower limit of the range, B2 is current output range upper limit, B1 is the lower limit, X is the currently read conductivity value, and C is the calculated current value. The list of commonly used values is as follows:

current(mA)	conductivityValue (ppm)	Calculation Process
4	0.0	$(2000-0)*(4-4)\div(20-4)+0$
5	125.0	$(2000-0)*(5-4)\div(20-4)+0$
6	250.0	$(2000-0)*(6-4)\div(20-4)+0$
7	375.0	$(2000-0)*(7-4)\div(20-4)+0$
8	500.0	$(2000-0)*(8-4)\div(20-4)+0$
9	625.0	$(2000-0)*(9-4)\div(20-4)+0$
10	750.0	$(2000-0)*(10-4)\div(20-4)+0$
11	875.0	$(2000-0)*(11-4)\div(20-4)+0$
12	1000.0	$(2000-0)*(12-4)\div(20-4)+0$
13	1125.0	$(2000-0)*(13-4)\div(20-4)+0$
14	1250.0	$(2000-0)*(14-4)\div(20-4)+0$
15	1375.0	$(2000-0)*(15-4)\div(20-4)+0$
16	1500.0	$(2000-0)*(16-4)\div(20-4)+0$
17	1625.0	$(2000-0)*(17-4)\div(20-4)+0$
18	1750.0	$(2000-0)*(18-4)\div(20-4)+0$
19	1875.0	$(2000-0)*(19-4)\div(20-4)+0$

20	2000.0	$(2000-0)*(20-4)\div(20-4)+0$
----	--------	-------------------------------

As shown in the above formula, when measuring 8mA, current current is 504ppm。

For example, the range is 0~2000ppm, the analog output is 0~5V DC0-5Vvoltage signal, conductivity and DC0-5Vvoltage The calculation relationship is as shown in the formula: $C = (A2-A1) * (X-B1) / (B2-B1) + A1$, where A2 is conductivity range upper limit, A1 is the lower limit of the range, B2 is DC0-5Vvoltage output range upper limit, B1 is the lower limit, X is the currently read conductivity value, and C is the calculated DC0-5Vvoltage value. The list of commonly used values is as follows:

DC0-5Vvoltage(V)	conductivityValue (ppm)	Calculation Process
0	0.0	$(2000-0)*(0-0)\div(5-0)+0$
1	400.0	$(2000-0)*(1-0)\div(5-0)+0$
2	800.0	$(2000-0)*(2-0)\div(5-0)+0$
3	1200.0	$(2000-0)*(3-0)\div(5-0)+0$
4	1600.0	$(2000-0)*(4-0)\div(5-0)+0$
5	2000.0	$(2000-0)*(5-0)\div(5-0)+0$

As shown in the above formula, when measuring 2.5V, current DC0-5Vvoltage is 1000ppm。

Disclaimer

This document provides all information about the product, does not grant any license to intellectual property, does not express or imply, and prohibits any other means of granting any intellectual property rights, such as the statement of sales terms and conditions of this product, other issues. No liability is assumed. Furthermore, our company makes no warranties, express or implied, regarding the sale and use of this product, including the suitability for the specific use of the product, the marketability or the infringement liability for any patent, copyright or other intellectual property rights, etc. Product specifications and product descriptions may be modified at any time without notice.

Contact Us

Company: Shanghai Sonbest Industrial Co., Ltd INTOIOT Brand Division

Address: Building 8, No.215 North east road, Baoshan District, Shanghai, China

Web: <http://www.intoiot.cn>

Web: <http://www.intoiot.com>

SKYPE: soobuu

Email: sale@sonbest.com

Tel: 86-021-51083595 / 66862055 / 66862075 / 66861077